

Riverbank Acoustical Laboratories (RAL)TM / An Alion Science Technical Center
 Sound Absorption and Sound Absorption Coefficients
 by the Reverberation Room Method ASTM C 423-07/NVLAP 08/P03

TEST NUMBER: A10-149 - B

TEST DATE: AUGUST 09, 2010

CLIENT: Pro Sound Foam
 DESIGNATION: 2in. Pro Sound Foam Studio Wedge
 DIMENSIONS: 106.875" x 95" x 2"
 AREA: 70.5 ft²
 WEIGHT: 15.5 lbs AREA WEIGHT: 0.22 lbs/ft²
 MOUNTING: A EDGE SEAL: Steel
 SPECIMEN DETAILS: 16@ 23.75" x 23.75" x 2" 4@ 11.875" x 23.75" x 2"

TEST ROOM DETAILS: Room 0 Volume = 10311 ft³ Area = 2864.3 ft²
 FILE NAME: A10_149_100809_B.doc

1/3 OCTAVE CENTER FREQ. (Hz)	ABSORPTION COEFFICIENT	TOTAL ABSORPTION (SABINS)
40	0.03	1.95
50	0.02	1.30
63	0.06	4.13
80	0.04	2.98
100	0.12	8.54
125	0.13	9.43
160	0.17	11.86
200	0.22	15.23
250	0.26	18.57
315	0.41	29.18
400	0.56	39.25
500	0.75	52.63
630	0.88	61.91
800	0.95	67.14
1000	0.96	67.61
1250	1.00	70.40
1600	1.04	73.57
2000	1.05	74.31
2500	1.06	74.57
3150	1.03	72.57
4000	1.04	73.13
5000	1.06	74.96
6300	1.05	73.89
8000	1.08	75.83
10000	1.08	76.35


SOUND ABSORPTION AVERAGE [SAA] = 0.76
NOISE REDUCTION COEFFICIENT [NRC] = 0.75

Test Conducted by: Dean Victor

This single report page and accompanying graph contain the instantaneous raw data as provided to the client after testing of the specimen. This data, although accurate, is incomplete without the full specimen description, mounting details and signature pages. The full report referenced by the RAL test number above should be consulted for further information regarding these results.

RIVERBANK ACOUSTICAL LABORATORIES

SOUND ABSORPTION REPORT
RAL - A10-149 - B

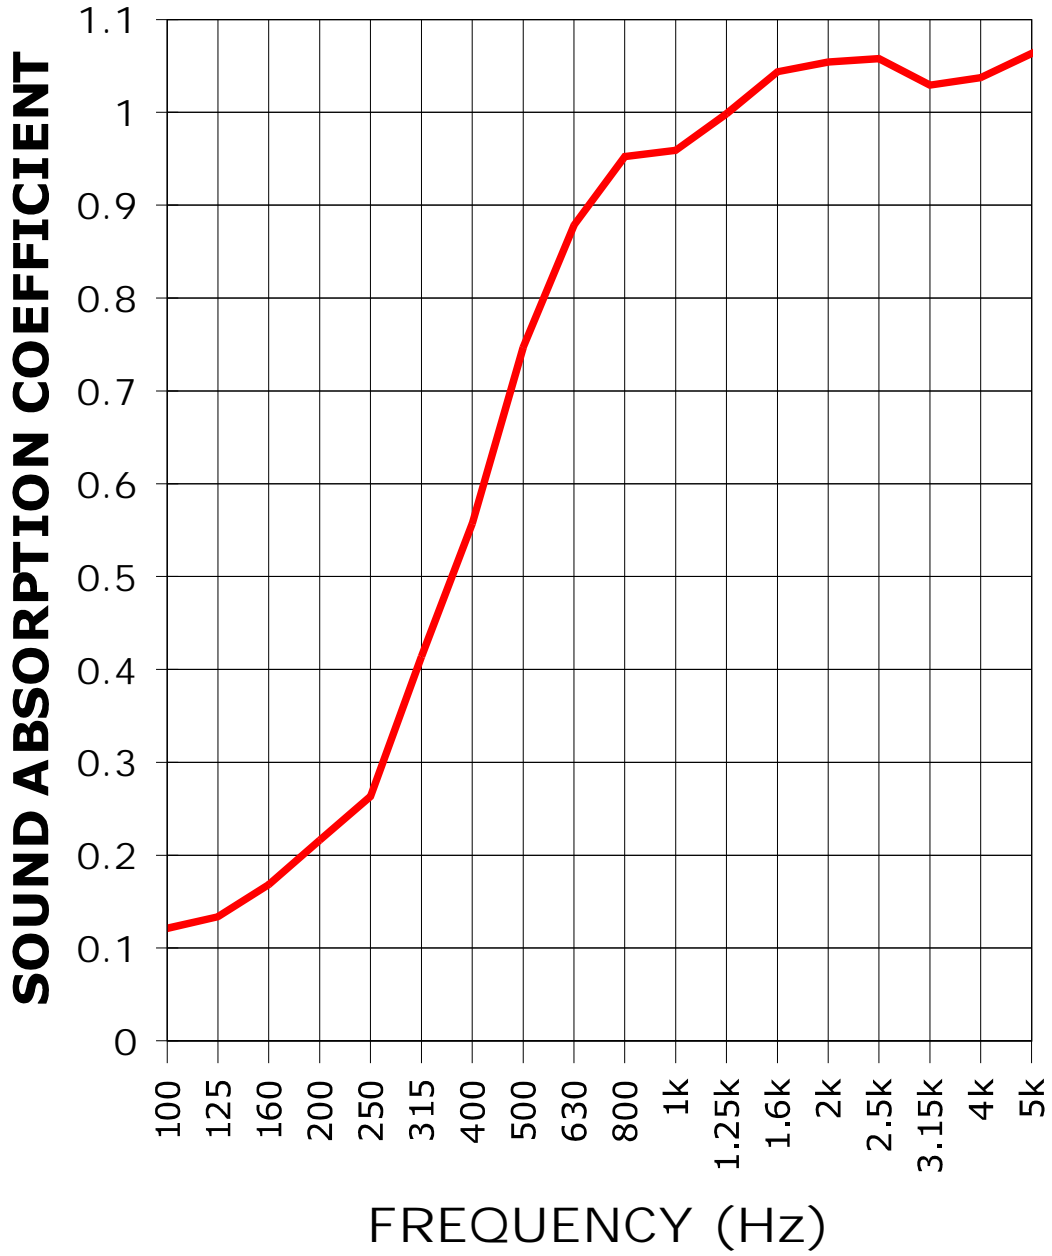

SAA = 0.76
NRC = 0.75